

SCOPE OF WORK

1. ADD FIRE SPRINKLERS BELOW NEW STAIR.

DESIGN CRITERIA

THROUGHOUT: PER NFPA #13 (2010 EDITION) AND THE CITY OF KIRKLAND
HAZARD: LIGHT

MATERIAL NOTES


1. ALL NEW PIPE TO BE BLACK, IMPORT SCHEDULE 40. IF NECESSARY, WSFP WILL USE FLEXIBLE SPRINKLER DROPS (FLEXHEADS) IN THE ACT.
2. ALL NEW FITTINGS TO BE BLACK, IMPORT CLASS 175 DUCTILE IRON. ADJUSTABLE DROP NIPPLES (ADN) TO BE USED IN ANY GWS CEILINGS.
3. ALL NEW HANGERS TO BE SAMMY SWG-20 UNLESS NOTED OTHERWISE.

GENERAL NOTES


1. ALL MATERIAL AND EQUIPMENT TO BE UL/FM APPROVED.
2. PIPING DIMENSIONS ARE CENTER TO CENTER EXCEPT RISER, DIMENSIONS AND MAINS SHOWN THUSLY (1-8) WHICH ARE END TO END.
3. EARTHQUAKE BRACING SHALL BE PROVIDED IN ACCORDANCE WITH NFPA PAMPHLET NO. 13.
4. PIPE HANGER AND METHOD OF HANGING TO BE IN ACCORDANCE WITH NFPA PAMPHLET NO. 13.
5. PIPING SHALL BE IN ACCORDANCE WITH NFPA PAMPHLET NO. 13.
6. JOINING OF PIPE AND FITTINGS, THREADED AND WELDED, SHALL BE IN ACCORDANCE WITH NFPA PAMPHLET NO. 13.
7. OWNER TO PROVIDE ADEQUATE HEAT TO PREVENT WATER IN PIPES FROM FREEZING IN AREAS PROTECTED BY A WET PIPE SPRINKLER SYSTEM.
8. STRUCTURAL ADEQUACY OF THE BUILDING TO SUPPORT THE SPRINKLER PIPING IS THE RESPONSIBILITY OF THE OWNER AND/OR HIS STRUCTURAL REPRESENTATIVE.
9. OWNER IS RESPONSIBLE FOR ALL APPROPRIATE MAINTENANCE AND PROTECTION OF THE FIRE SPRINKLER SYSTEM.
10. ALL WIRING OF ELECTRICAL COMPONENTS TO BE DONE BY OTHERS.
11. PAINTING OF PIPE, PREPARATION OR PROTECTION OF PIPE FOR PAINTING SHALL BE PROVIDED BY OTHERS AND IS NOT PART OF THIS CONTRACT.
12. THE FIRE SPRINKLER SYSTEMS SHALL BE MONITORED 24 HOURS A DAY BY A CENTRAL STATION AND IS NOT PART OF THIS CONTRACT.

FOREMAN NOTES

1. ADD SPRINKLERS BELOW NEW STAIR.
2. INSTALL DRAIN VALVE BELOW STAIR.

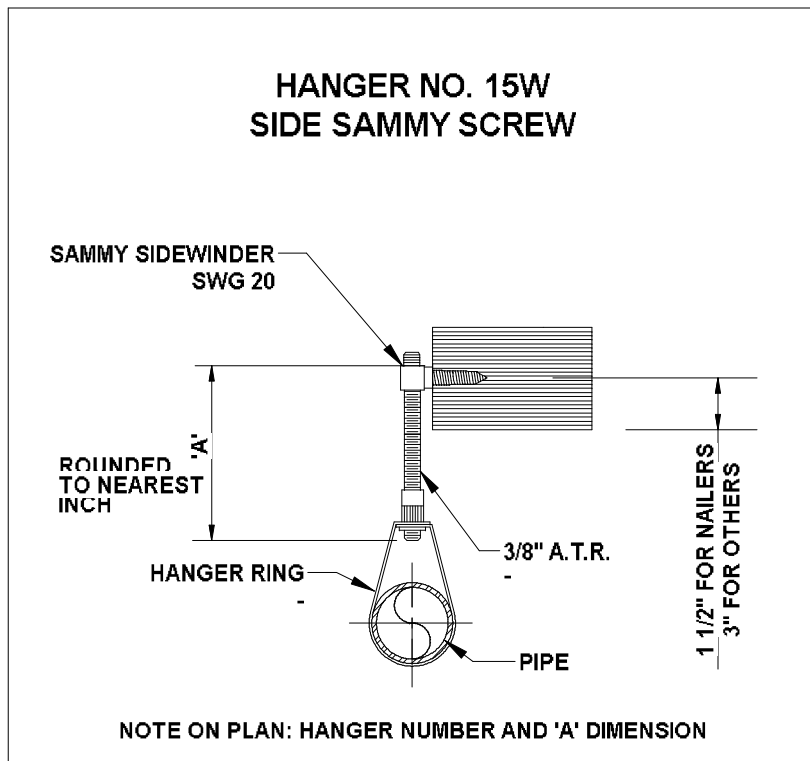


NE 116TH STREET

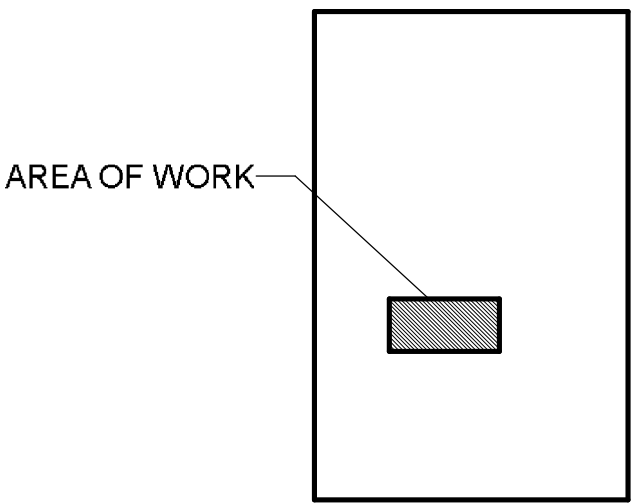


FIRE SPRINKLER PLAN - LEVEL 1
SCALE: 1/8" = 1'-0"




JChappell
03/31/2015



KEY PLAN
SCALE: NONE

SYMBOL LEGEND		REVISIONS			SPRINKLER LEGEND										SPRINKLER LEGEND										APPROVAL: CITY OF KIRKLAND			<div><div>Western States Fire Protection Company</div><div>14890 NE 98th St Unit 01, Redmond, WA 98052</div><div>LC #: WESTESF1360F</div><div>WESTERN STATES FIRE PROTECTION COMPANY - OFFICES LOCATED</div><div>ALBUQUERQUE AUSTIN DALLAS DENVER DENVER DOUTHAMSTON KANSAS CITY</div><div>LAS VEGAS MINNEAPOLIS PHOENIX PORTLAND RAINIER CITY ST. PAUL SALT LAKE CITY SEATTLE</div><div>DATE: MARCH 24, 2015 Fax: 425-881-3030</div></div>	SHRKT FP-01 OF 1
NO.	DESCRIPTION	DATE	SYMBOL	DESCRIPTION	ORIF.	K.	TEMP.	FINISH	NO. REQ.	SYMBOL	DESCRIPTION	ORIF.	K.	TEMP.	FINISH	NO. REQ.	CONT. NO.: KS2762												
				EXISTING PENDENT	1/2"	5.6	155°F	-	-		EXISTING UPRIGHT	1/2"	5.6	155°F	-	-		DRAWN BY: JIM STEWART											
				EXISTING UPRIGHT	1/2"	5.6	155°F	-	-		UPRIGHT - RELIABLE F1 (SR)	1/2"	5.6	155°F	BRASS	A-3		SPRK. ON SHEET: 3											
																		SPRK. ON JOB: 3											
																		DATE: MARCH 24, 2015											



Western States Fire Protection Company
14890 NE 85th St. Unit 101, Redmond, WA 98052
Lic. # WESTSF1360F

WESTERN STATES FIRE PROTECTION COMPANY - OFFICES LOCATED:
ALBUQUERQUE / AUSTIN / DALLAS / DENVER / DULUTH / HOUSTON / KANSAS CITY
LAS VEGAS / MINNEAPOLIS / PHOENIX / PORTLAND / RENO / SAN ANTONIO / SEATTLE
Phone: 425-881-0100 Fax: 425-881-3030

GYMNASTICS CONNECTIONS
11801 NE 116TH STREET
KIRKLAND, WA 98034
SUITE --

SHEET
FP-01
OF
1